




**11 WEST LOBBY STOREFRONT DOOR**  
SCALE: 3/4" = 1'-0"

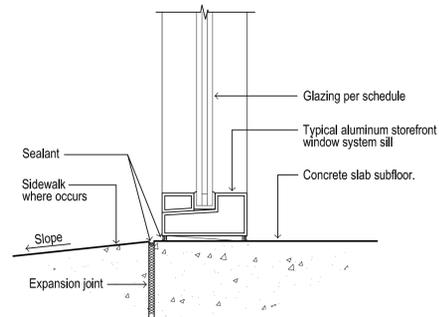


**7 WINDOW SILL @ SLAB**  
SCALE: 3" = 1'-0"

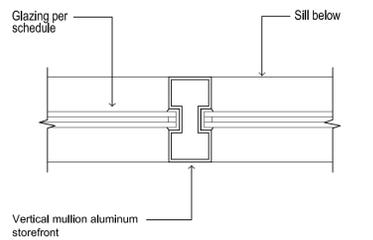


**10 DOUBLE FIXED WINDOW JAMB**  
SCALE: 3" = 1'-0"

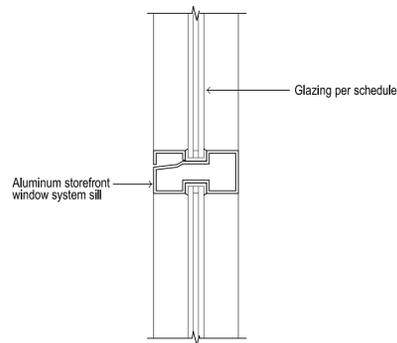


**9 TYP. HORIZ. INTERMEDIATE SILL**  
SCALE: 3" = 1'-0"

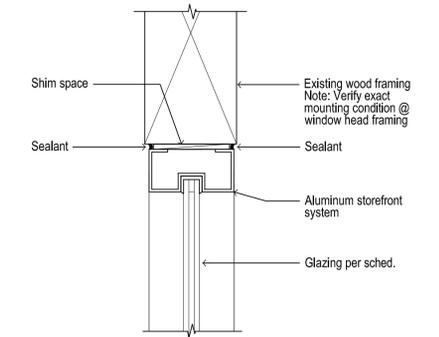


**6 WINDOW HEAD**  
SCALE: 3" = 1'-0"

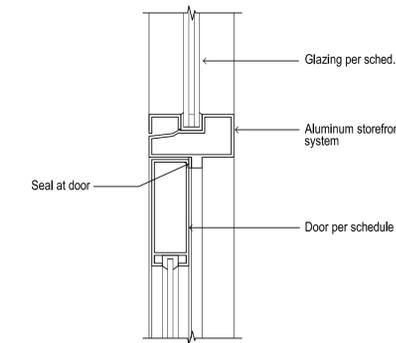

**5 DOOR/WINDOW HEAD**  
SCALE: 3" = 1'-0"

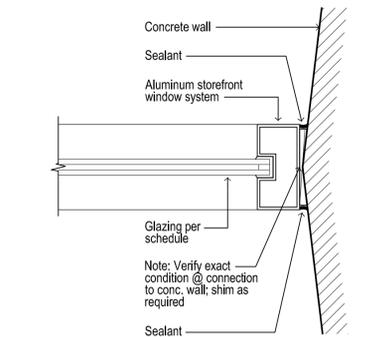

**8 WINDOW JAMB**  
SCALE: 3" = 1'-0"

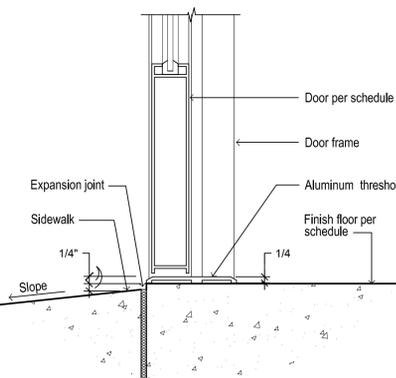


**4 DOOR SILL**  
SCALE: 3" = 1'-0"

DOOR SCHEDULE (SEE DOOR NOTES THIS SHEET)														
#	LOCATION	SIZE			CORE	MATERIAL		FINISH		DETAILS			REMARKS	
		WIDTH	HT.	THICK		DOOR	FRAME	DOOR	FRAME	HEAD	JAMB	JAMB		SILL
101	LOBBY WEST	3'-0"	7'-0"	1 3/4"	-	ALUM/GL	ALUM	*BRONZE-ANOD	*BRONZE-ANOD	4/A5	2/A5	1/A5	3/A5	PROVIDE TEMPERED GLASS DOOR PANEL, PANIC BAR, CLOSER & DOOR STOP
														*TO MATCH EXISTING

WINDOW SCHEDULE (SEE WINDOW NOTES THIS SHEET)												
TYPE	SIZE (WIDTH X HEIGHT)	MATERIAL		FINISH		REMARKS						
		FRAME	GLAZING	FRAME	GLAZING							
(A)	18'-6" x 10'-0" (VERIFY)	ALUM	DBL	*BRONZE	*TINT	PROVIDE TEMPERED GLASS PER "WINDOW NOTES" #2						
						*TO MATCH EXISTING						

FINISH SCHEDULE (SEE FINISH NOTES THIS SHEET)														
ROOM NAME	FLOOR	BASE	NORTH WALL		EAST WALL		SOUTH WALL		WEST WALL		CEILING		REMARKS	
			MAT.	FIN.	MAT.	FIN.	MAT.	FIN.	MAT.	FIN.	MAT.	FIN.		HT.
LOBBY EAST	CT	VB	-	-	-	-	-	-	-	-	ACT	-	-	EXISTING CONC. WALLS TO REMAIN AS IS
LOBBY WEST	CT	VB	-	-	-	-	-	-	GWB	LSP	ACT	-	-	EXISTING CONC. WALLS TO REMAIN AS IS

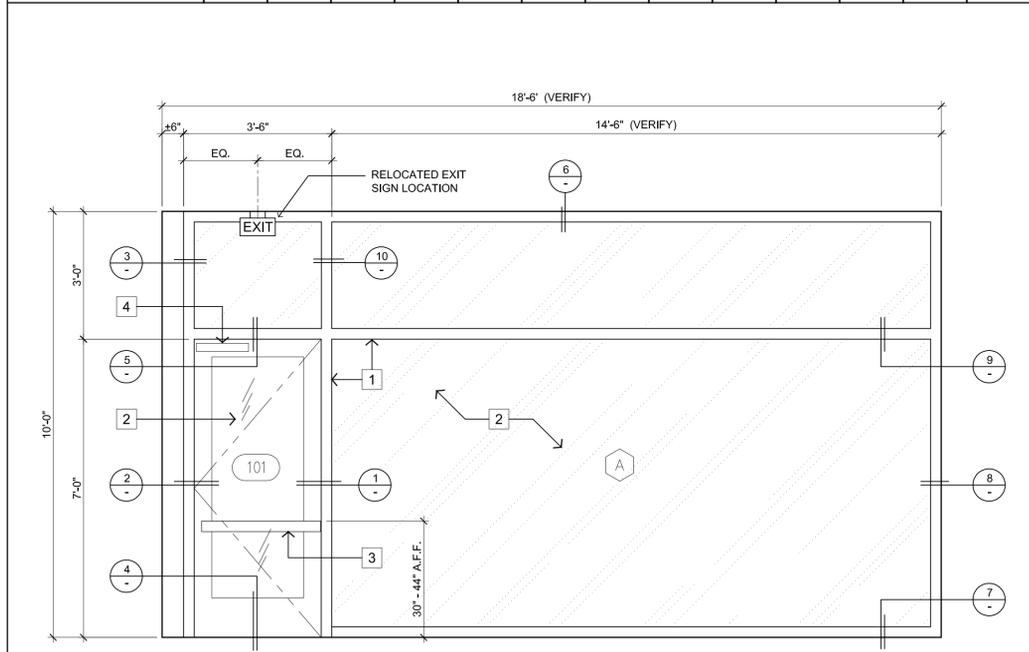

**LOBBY WEST SOUTH WALL ELEVATION**  
SCALE: 1/2" = 1'-0"


FINISH LEGEND	
<b>MATERIALS</b>	
ACT	EXISTING ACOUSTICAL CEILING TILE TO REMAIN
CT	CARPET TILES TO MATCH EXISTING
GWB	5/8" GYPSUM WALLBOARD
LSP	LOW SHEEN (EGGSHELL) PAINT
VB	VINYL BASE TO MATCH EXISTING

FINISH NOTES	
1.	INTERIOR FINISH MATERIALS APPLIED TO WALL & CEILINGS SHALL BE TESTED AS SPECIFIED IN SECTION 803.


DOOR & WINDOW NOTES	
1	TYPICAL ALUMINUM STOREFRONT FRAME. MATCH EXISTING FINISH.
2	TEMPERED GLASS PER WINDOW NOTE #2. MATCH EXISTING TINT.
3	PANIC BAR MOUNTED 30"-44" A.F.F. PROVIDE ALARM DEVICE & SIGNAGE FOR EMERGENCY EXIT DOOR.
4	CLOSER

DOOR NOTES	
1.	EXIT DOORS SHALL SWING IN THE DIRECTION OF EXIT TRAVEL WHEN SERVING ANY HAZARDOUS AREA OR WHEN SERVING AN OCCUPANT LOAD OF 50 OR MORE (TITLE 24, 1003.3.1.5)
2.	EXIT DOORS SHALL BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. FLUSH BOLTS OR SURFACE BOLTS ARE PROHIBITED. THE UNLATCHING OF ANY LEAF SHALL NOT REQUIRE MORE THAN ONE OPERATION. (TITLE 24, 1003.3.1.8)
3.	WIDTH & HEIGHT OF EXIT DOORWAYS TO COMPLY WITH TITLE 24. (TITLE 24, 1003.3.1.3)
4.	THE BOTTOM 10" OF ALL DOORS SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE.
5.	ALL MEANS OF EGRESS DOORS SHALL COMPLY WITH THE REQUIREMENTS OF SECTION 1008.1 AND SECTION 1018.2. <ul style="list-style-type: none"> <li>a. MEANS OF EGRESS DOORS SHALL BE READILY DISTINGUISHABLE FROM THE ADJACENT CONSTRUCTION AND FINISHES WITH NO MIRRORS, CURTAINS, DRAPES, DECORATIONS, OR SIMILAR MATERIAL.</li> <li>b. REQUIRED EXIT DOORS SHALL HAVE NOT LESS THAN 32-IN. CLEAR WIDTH, 80-IN. CLEAR HEIGHT, AND SHALL BE CAPABLE OF OPENING 90 DEGREES. THE MAXIMUM SWINGING DOOR LEAF WIDTH IS 4-FT. NOMINAL.</li> <li>c. EGRESS DOORS SHALL BE SIDE-HINGED SWINGING.</li> <li>d. THE OPENING FORCE FOR INTERIOR SIDE-SWINGING DOORS WITHOUT CLOSERS SHALL NOT EXCEED A 5-POUND FORCE. FOR OTHER SIDE SWINGING, SLIDING AND FOLDING DOORS, THE DOOR LATCH SHALL RELEASE WHEN SUBJECTED TO A 15-POUND FORCE.</li> <li>e. REVOLVING AND SLIDING DOORS MAY BE USED IN OTHER THAN GROUP H OCCUPANCIES AS EGRESS DOORS ONLY IF ALL OF THE REQUIREMENTS OF SECTION 1008.1.3.1 AND SECTION 1008.1.3.3, RESPECTIVELY, ARE MET.</li> </ul>
6.	PANIC AND FIRE EXIT HARDWARE, WHERE INSTALLED ON DOORS IN THIS BUILDING, SHALL SATISFY THE FOLLOWING: (1008.1.9) <ul style="list-style-type: none"> <li>a. THE ACTUATING PORTION OF THE RELEASING DEVICE SHALL EXTEND AT LEAST ONE-HALF OF THE DOOR LEAF WIDTH.</li> <li>b. THE MAXIMUM UNLATCHING FORCE DOES NOT EXCEED 15-POUND.</li> <li>c. PIVOTED OR BALANCED DOORS SHALL BE OF THE PUSH-PAD TYPE WHERE PANIC HARDWARE IS REQUIRED, AND THE PAD SHALL NOT EXTEND ACROSS MORE THAN ONE-HALF OF THE DOOR WIDTH, MEASURED FROM THE LATCH SIDE.</li> </ul>
7.	WHERE KEY-OPERATED LOCKING DEVICES ARE USED, POST A SIGN ON OR ADJACENT TO THE REQUIRED MAIN EXIT DOOR WITH 1-IN. LETTERING STATING: "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED." (1008.1.8.3)
8.	EGRESS DOORS OR GATES SHALL BE OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY, SPECIAL KNOWLEDGE, OR EFFORT. DOOR HANDLES, PULLS, LATCHES, LOCKS, AND OTHER OPERATING DEVICES SHALL BE INSTALLED 34 TO 48 IN. ABOVE THE FINISHED FLOOR. MANUALLY OPERATED FLUSH BOLTS OR SURFACE BOLTS ARE NOT PERMITTED. THE UNLATCHING OF ANY DOOR OR LEAF SHALL NOT REQUIRE MORE THAN ONE OPERATION. (1008.1.8)
9.	THE FLOOR OR LANDING ON EACH SIDE OF DOORS SHALL NOT BE MORE THAN 1/2-IN. LOWER THAN THE THRESHOLD OF THE DOORWAY. RAISED THRESHOLDS AND FLOOR LEVEL CHANGES GREATER THAN 1/4-IN. AT DOORWAYS SHALL BE BEVELED WITH A SLOPE NOT GREATER THAN ONE UNIT VERTICAL IN TWO UNITS HORIZONTAL (50% SLOPE). (1008.1.6)


WINDOW NOTES	
1.	PROVIDE GLASS COMPLYING WITH CHAPTER 24, UBC.
2.	PROVIDE TEMPERED GLASS AS REQUIRED FOR HAZARDOUS LOCATIONS BY CHAPTER 24, UBC. IN NEW DOORS, ADJACENT TO NEW DOORS, & IN ALL NEW GLAZING WITHIN 18" FROM THE FLOOR.
3.	EACH LIGHT OF SAFETY GLAZING MATERIAL INSTALLED IN HAZARDOUS LOCATIONS SHALL BE IDENTIFIED BY A PERMANENT LABEL THAT SPECIFIES THE LABELER, AND STATES THAT SAFETY-GLAZING MATERIAL HAS BEEN UTILIZED IN SUCH INSTALLATIONS. THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSE OF SAFETY GLAZING, GLAZING IN: <ul style="list-style-type: none"> <li>A. INGRESS AND EGRESS DOOR.</li> <li>B. FIXED AND SLIDING PANELS OF SLIDING DOOR ASSEMBLIES AND PANELS IN SWINGING DOORS OTHER THAN WARDROBE DOOR.</li> <li>C. STORM DOORS.</li> <li>D. ALL UNFRAMED SWINGING DOORS.</li> <li>E. DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, AND SHOWERS.</li> <li>F. FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN 24 INCHES (610 mm) ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES (1525 mm) ABOVE THE WALKING SURFACE.</li> <li>G. AN INDIVIDUAL FIXED OR OPERABLE PANEL, OTHER THAN DESCRIBED IN ITEMS 'E' AND 'F', THAT MEET ALL OF THE FOLLOWING CONDITIONS:               <ul style="list-style-type: none"> <li>i. EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQUARE FEET (0.84 m<sup>2</sup>).</li> <li>ii. EXPOSED BOTTOM EDGE LESS THAN 18 INCHES (457 mm) ABOVE THE FLOOR.</li> <li>iii. EXPOSED TOP EDGE GREATER THAN 36 INCHES (914 mm) ABOVE THE FLOOR.</li> <li>iv. ONE OR MORE WALKING SURFACES WITHIN 36 INCHES (914 mm) HORIZONTALLY OF THE PLANE OF THE GLAZING.</li> </ul> </li> </ul>

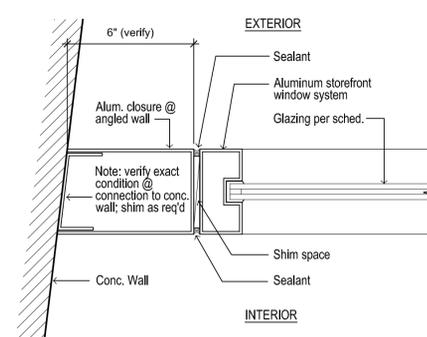

**3 WINDOW JAMB**  
SCALE: 3" = 1'-0"

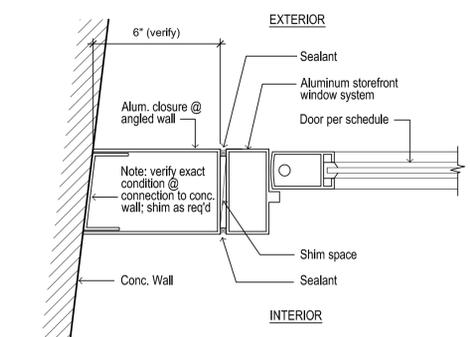

**2 DOOR JAMB**  
SCALE: 3" = 1'-0"

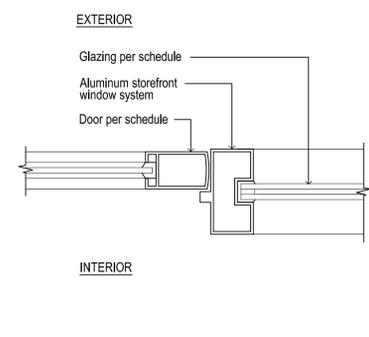

**1 DOOR JAMB AT WINDOW**  
SCALE: 3" = 1'-0"

**WILLIAM LOYD JONES ARCHITECT**  
723 oceanfront walk  
venice, california  
90291

**DOOR, WINDOW & FINISH SCHEDULES, DETAILS**  
**TORRANCE LIBRARY LOBBY REMODEL**  
KATY GEISERT CIVIC CENTER LIBRARY  
3301 TORRANCE BOULEVARD  
TORRANCE, CALIFORNIA 90503

Issue	
DESIGN OPTIONS 1 THRU 6	10.APR.13
DESIGN OPTIONS 7 & 8	3.MAY.13
DESIGN UPDATE	9.MAY.13
DESIGN DEVELOPMENT	21.MAY.13
FINAL DESIGN	30.JULY.13
CONSTRUCTION DOCUMENTS	30.AUG.13
REVISED (N.I.C.)	21.JAN.14

THE ABOVE DRAWINGS AND SPECIFICATIONS AND IDEAL DESIGNS AND IMPROVEMENTS REPRESENTED THEREIN ARE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT AND NO PART THEREOF SHALL BE COPIED, REPRODUCED OR IN ANY MANNER USED IN CONNECTION WITH ANY OTHER PROJECT OTHER THAN THE PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DELIVERED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT. VISUAL CONFUSION WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF THESE RESTRICTIONS.

Date	18.MAR.13
Drawn	KC
Checked	WLJ
Scale	1/4" = 1'-0"
Job. No.	--

- i. EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQUARE FEET (0.84 m<sup>2</sup>).
- ii. EXPOSED BOTTOM EDGE LESS THAN 18 INCHES (457 mm) ABOVE THE FLOOR.
- iii. EXPOSED TOP EDGE GREATER THAN 36 INCHES (914 mm) ABOVE THE FLOOR.
- iv. ONE OR MORE WALKING SURFACES WITHIN 36 INCHES (914 mm) HORIZONTALLY OF THE PLANE OF THE GLAZING.

**A5**

TEL 310 392 3995 FAX 310 392 2857